



March 30, 2017

**Via E-Mail: Joshua\_I\_williams@dekalbschoolsga.org**

Mr. Joshua L. Williams, MBA, MSM, PMP  
Chief Operations Officer  
DeKalb County School District  
Operations Division  
Sam Moss Service Center  
1780 Montreal Road  
Tucker, Georgia 30084

**Re: Lead in Drinking Water Sample Results  
Narvie Harris Elementary School (Facility ID #0100)  
3981 McGill Drive, Decatur, Georgia 30034  
AEM Project No. 1561-1601**

Dear Mr. Williams:

Atlanta Environmental Management, Inc. (AEM) is pleased to provide the DeKalb County School District (DCSD) an electronic copy of the Lead in Drinking Water Sample Results for Narvie Harris Elementary School (Facility ID #0100). Samples were collected on March 14, 2017, and analytical results were received from Analytical Environmental Services, Inc., on March 28, 2017.

## **FINDINGS**

AEM collected 128 drinking water samples from 64 sources at Narvie Harris Elementary School (Facility ID #0100), including two duplicate samples. A description of the drinking water outlets sampled and a summary of sample analytical results are provided in the attached table.

One of the sources sampled had a drinking water sample result that contained lead at a concentration at or above EPA's action level of 15 parts per billion. This source is indicated in bold and shaded font in the attached table.


We appreciate your selection of AEM for this project. If you have any questions, please do not hesitate to contact us.

Sincerely,

**Atlanta Environmental Management, Inc.**



Leona Miles, CHMM  
Senior Project Manager

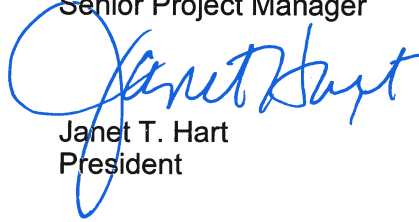

Janet T. Hart  
President

/krf

cc: Daniel Drake (DCSD)  
Tracee Hill (DCSD)  
Sandra Glenn (DeKalb County Watershed Management)  
Ryan Cira (DeKalb Board of Health)

Attachment: Table

**Table 1. Summary of Lead in Drinking Water Laboratory Analytical Results**

**Narvie Harris Elementary School**

3981 McGill Drive, Decatur, GA 30034



Sample ID*	Sample Location Description	Sample Date & Time	Lead Test Results (ppb)
0100-031417-DF-001-A	Initial Draw sample; Upper Left wall mounted Elkay Drinking Fountain in Gym	3/14/17 5:08 AM	None Detected
0100-031417-DF-001-B	Flush sample; Upper Left wall mounted Elkay Drinking Fountain in Gym	3/14/17 5:09 AM	None Detected
0100-031417-DF-002-A	Initial Draw sample; Lower Right wall mounted Elkay Drinking Fountain in Gym	3/14/17 5:10 AM	None Detected
0100-031417-DF-002-B	Flush sample; Lower Right wall mounted Elkay Drinking Fountain in Gym	3/14/17 5:11 AM	None Detected
0100-031417-DF-003-A	Initial Draw sample; Lower Left wall mounted Halsey Taylor Drinking Fountain in Cafeteria	3/14/17 5:10 AM	None Detected
0100-031417-DF-003-B	Flush sample; Lower Left wall mounted Halsey Taylor Drinking Fountain in Cafeteria	3/14/17 5:11 AM	None Detected
0100-031417-DF-004-A	Initial Draw sample; Upper Right wall mounted Halsey Taylor Drinking Fountain in Cafeteria	3/14/17 5:12 AM	None Detected
0100-031417-DF-004-B	Flush sample; Upper Right wall mounted Halsey Taylor Drinking Fountain in Cafeteria	3/14/17 5:13 AM	None Detected
0100-031417-DF-005-A	Initial Draw sample; Upper Left wall mounted Halsey Taylor Drinking Fountain in hallway outside Cafeteria entrance	3/14/17 5:02 AM	None Detected
0100-031417-DF-005-B	Flush sample; Upper Left wall mounted Halsey Taylor Drinking Fountain in hallway outside Cafeteria entrance	3/14/17 5:03 AM	None Detected
0100-031417-DF-006-A	Initial Draw sample; Lower Right wall mounted Halsey Taylor Drinking Fountain in hallway outside Cafeteria entrance	3/14/17 5:04 AM	None Detected
0100-031417-DF-006-B	Flush sample; Lower Right wall mounted Halsey Taylor Drinking Fountain in hallway outside Cafeteria entrance	3/14/17 5:05 AM	None Detected
0100-031417-DF-007-A	Initial Draw sample; Upper Left wall mounted Halsey Taylor Drinking Fountain in hallway to right of Counselor's office Rm 305	3/14/17 5:23 AM	None Detected
0100-031417-DF-007-B	Flush sample; Upper Left wall mounted Halsey Taylor Drinking Fountain in hallway to right of Counselor's office Rm 305	3/14/17 5:24 AM	None Detected
0100-031417-DF-008-A	Initial Draw sample; Lower Right wall mounted Halsey Taylor Drinking Fountain in hallway to right of Counselor's office Rm 305	3/14/17 5:25 AM	None Detected
0100-031417-DF-008-B	Flush sample; Lower Right wall mounted Halsey Taylor Drinking Fountain in hallway to right of Counselor's office Rm 305	3/14/17 5:26 AM	None Detected

**Table 1. Summary of Lead in Drinking Water Laboratory Analytical Results**  
**Narvie Harris Elementary School**  
**3981 McGill Drive, Decatur, GA 30034**



Sample ID*	Sample Location Description	Sample Date & Time	Lead Test Results (ppb)
0100-031417-DF-009-A	Initial Draw sample; Upper Right wall mounted Halsey Taylor Drinking Fountain in hallway near Rm 502	3/14/17 6:09 AM	None Detected
0100-031417-DF-009-B	Flush sample; Upper Right wall mounted Halsey Taylor Drinking Fountain in hallway near Rm 502	3/14/17 6:10 AM	None Detected
0100-031417-DF-010-A	Initial Draw sample; Lower Left wall mounted Halsey Taylor Drinking Fountain in hallway near Rm 502	3/14/17 5:05 AM	None Detected
0100-031417-DF-010-B	Flush sample; Lower Left wall mounted Halsey Taylor Drinking Fountain in hallway near Rm 502	3/14/17 5:06 AM	None Detected
0100-031417-DF-011-A	Initial Draw sample; Lower Right wall mounted Halsey Taylor Drinking Fountain in hallway to left of Rm 306	3/14/17 5:17 AM	None Detected
0100-031417-DF-011-B	Flush sample; Lower Right wall mounted Halsey Taylor Drinking Fountain in hallway to left of Rm 306	3/14/17 5:18 AM	None Detected
0100-031417-DF-012-A	Initial Draw sample; Upper Left wall mounted Halsey Taylor Drinking Fountain in hallway to left of Rm 306	3/14/17 5:19 AM	None Detected
0100-031417-DF-012-B	Flush sample; Upper Left wall mounted Halsey Taylor Drinking Fountain in hallway to left of Rm 306	3/14/17 5:20 AM	None Detected
0100-031417-DF-013-A	Initial Draw sample; Lower Right wall mounted Halsey Taylor Drinking Fountain in hallway to left of Rm 202	3/14/17 5:21 AM	None Detected
0100-031417-DF-013-B	Flush sample; Lower Right wall mounted Halsey Taylor Drinking Fountain in hallway to left of Rm 202	3/14/17 5:22 AM	None Detected
0100-031417-DF-014-A	Initial Draw sample; Upper Left wall mounted Halsey Taylor Drinking Fountain in hallway to left of Rm 202	3/14/17 5:23 AM	None Detected
0100-031417-DF-014-B	Flush sample; Upper Left wall mounted Halsey Taylor Drinking Fountain in hallway to left of Rm 202	3/14/17 5:24 AM	None Detected
0100-031417-DF-015-A	Initial Draw sample; Right wall mounted Elkay Drinking Fountain in hallway to left of Rm 406	3/14/17 5:43 AM	None Detected
0100-031417-DF-015-B	Flush sample; Right wall mounted Elkay Drinking Fountain in hallway to left of Rm 406	3/14/17 5:44 AM	None Detected

**Table 1. Summary of Lead in Drinking Water Laboratory Analytical Results**

**Narvie Harris Elementary School**

3981 McGill Drive, Decatur, GA 30034



Sample ID*	Sample Location Description	Sample Date & Time	Lead Test Results (ppb)
0100-031417-DF-016-A	Initial Draw sample; Left wall mounted Halsey Taylor Drinking Fountain in hallway to left of Rm 406	3/14/17 5:41 AM	None Detected
0100-031417-DF-016-B	Flush sample; Left wall mounted Halsey Taylor Drinking Fountain in hallway to left of Rm 406	3/14/17 5:42 AM	None Detected
0100-031417-KS-001-A	Initial Draw sample; Sink with bubbler in Rm 101; Sampled from faucet	3/14/17 5:38 AM	2.52
0100-031417-KS-001-B	Flush sample; Sink with bubbler in Rm 101; Sampled from faucet	3/14/17 5:39 AM	None Detected
0100-031417-KS-002-A	Initial Draw sample; Sink with bubbler in Rm 103; Sampled from faucet	3/14/17 5:43 AM	None Detected
0100-031417-KS-002-B	Flush sample; Sink with bubbler in Rm 103; Sampled from faucet	3/14/17 5:44 AM	None Detected
0100-031417-KS-003-A	Initial Draw sample; Sink with bubbler in Rm 105; Sampled from faucet	3/14/17 5:49 AM	None Detected
0100-031417-KS-003-B	Flush sample; Sink with bubbler in Rm 105; Sampled from faucet	3/14/17 5:50 AM	None Detected
0100-031417-KS-004-A	Initial Draw sample; Sink with bubbler in Rm 107; Sampled from faucet	3/14/17 5:54 AM	7.94
0100-031417-KS-004-B	Flush sample; Sink with bubbler in Rm 107; Sampled from faucet	3/14/17 5:55 AM	None Detected
0100-031417-KS-005-A	Initial Draw sample; Sink with bubbler in Rm 106; Sampled from faucet	3/14/17 5:51 AM	None Detected
0100-031417-KS-005-B	Flush sample; Sink with bubbler in Rm 106; Sampled from faucet	3/14/17 5:52 AM	None Detected
0100-031417-KS-006-A	Initial Draw sample; Sink with bubbler in Rm 104; Sampled from faucet; Dripping on arrival	3/14/17 5:46 AM	None Detected
0100-031417-KS-006-B	Flush sample; Sink with bubbler in Rm 104; Sampled from faucet; Dripping on arrival	3/14/17 5:47 AM	None Detected
0100-031417-KS-007-A	Initial Draw sample; Sink with bubbler in Rm 102; Sampled from faucet	3/14/17 5:40 AM	1.64
0100-031417-KS-007-B	Flush sample; Sink with bubbler in Rm 102; Sampled from faucet	3/14/17 5:41 AM	None Detected
0100-031417-KS-008-A	Initial Draw sample; Sink with bubbler in Rm 100; Sampled from faucet	3/14/17 5:35 AM	None Detected
0100-031417-KS-008-B	Flush sample; Sink with bubbler in Rm 100; Sampled from faucet	3/14/17 5:36 AM	None Detected
0100-031417-OT-001-A	Initial Draw sample; Sink with no bubbler in Rm 203; Sampled from faucet	3/14/17 5:27 AM	1.47
0100-031417-OT-001-B	Flush sample; Sink with no bubbler in Rm 203; Sampled from faucet	3/14/17 5:28 AM	None Detected
0100-031417-OT-002-A	Initial Draw sample; Sink with no bubbler in Rm 205; Sampled from faucet	3/14/17 5:30 AM	4.37
0100-031417-OT-002-B	Flush sample; Sink with no bubbler in Rm 205; Sampled from faucet	3/14/17 5:31 AM	9.12
0100-031417-OT-003-A	Initial Draw sample; Sink with no bubbler in Rm 207; Sampled from faucet	3/14/17 6:00 AM	None Detected
0100-031417-OT-003-B	Flush sample; Sink with no bubbler in Rm 207; Sampled from faucet	3/14/17 6:01 AM	None Detected

**Table 1. Summary of Lead in Drinking Water Laboratory Analytical Results**

**Narvie Harris Elementary School**

3981 McGill Drive, Decatur, GA 30034



Sample ID*	Sample Location Description	Sample Date & Time	Lead Test Results (ppb)
0100-031417-OT-004-A	Initial Draw sample; Sink with bubbler in Rm 209; Sampled from faucet	3/14/17 5:34 AM	None Detected
0100-031417-OT-004-B	Flush sample; Sink with bubbler in Rm 209; Sampled from faucet	3/14/17 5:35 AM	None Detected
0100-031417-OT-005-A	Initial Draw sample; Sink with no bubbler in Rm 211; Sampled from faucet	3/14/17 5:38 AM	None Detected
0100-031417-OT-005-B	Flush sample; Sink with no bubbler in Rm 211; Sampled from faucet	3/14/17 5:39 AM	None Detected
0100-031417-OT-006-A	Initial Draw sample; Sink with no bubbler in Rm 210; Sampled from faucet	3/14/17 5:42 AM	None Detected
0100-031417-OT-006-B	Flush sample; Sink with no bubbler in Rm 210; Sampled from faucet	3/14/17 5:43 AM	None Detected
0100-031417-OT-007-A	Initial Draw sample; Sink with no bubbler in Rm 208; Sampled from faucet	3/14/17 5:45 AM	None Detected
0100-031417-OT-007-B	Flush sample; Sink with no bubbler in Rm 208; Sampled from faucet	3/14/17 5:46 AM	None Detected
0100-031417-OT-008-A	Initial Draw sample; Sink with no bubbler in Rm 206; Sampled from faucet	3/14/17 5:47 AM	None Detected
0100-031417-OT-008-B	Flush sample; Sink with no bubbler in Rm 206; Sampled from faucet	3/14/17 5:48 AM	None Detected
0100-031417-OT-009-A	Initial Draw sample; Sink with no bubbler in Rm 204; Sampled from faucet	3/14/17 5:50 AM	None Detected
0100-031417-OT-009-B	Flush sample; Sink with no bubbler in Rm 204; Sampled from faucet	3/14/17 5:51 AM	None Detected
0100-031417-OT-010-A	Initial Draw sample; Sink with no bubbler in Rm 202; Sampled from faucet	3/14/17 5:52 AM	<b>20.6</b>
0100-031417-OT-010-B	Flush sample; Sink with no bubbler in Rm 202; Sampled from faucet	3/14/17 5:53 AM	13.2
0100-031417-OT-011-A	Initial Draw sample; Sink with no bubbler in Rm 301; Sampled faucet	3/14/17 5:04 AM	1.40
0100-031417-OT-011-B	Flush sample; Sink with no bubbler in Rm 301; Sampled faucet	3/14/17 5:05 AM	None Detected
0100-031417-OT-012-A	Initial Draw sample; Sink with no bubbler in Rm 303; Sampled faucet	3/14/17 5:08 AM	None Detected
0100-031417-OT-012-B	Flush sample; Sink with no bubbler in Rm 303; Sampled faucet	3/14/17 5:09 AM	None Detected
0100-031417-OT-013-A	Initial Draw sample; Sink with no bubbler in Rm 305; Sampled faucet	3/14/17 5:13 AM	None Detected
0100-031417-OT-013-B	Flush sample; Sink with no bubbler in Rm 305; Sampled faucet	3/14/17 5:14 AM	None Detected
0100-031417-OT-014-A	Initial Draw sample; Sink with no bubbler in Rm 307; Sampled faucet	3/14/17 5:23 AM	1.39
0100-031417-OT-014-B	Flush sample; Sink with no bubbler in Rm 307; Sampled faucet	3/14/17 5:24 AM	None Detected
0100-031417-OT-015-A	Initial Draw sample; Sink with no bubbler in Rm 309; Sampled faucet	3/14/17 5:27 AM	1.04
0100-031417-OT-015-B	Flush sample; Sink with no bubbler in Rm 309; Sampled faucet	3/14/17 5:28 AM	None Detected
0100-031417-OT-016-A	Initial Draw sample; Sink with no bubbler in Rm 311; Sampled faucet	3/14/17 5:30 AM	None Detected
0100-031417-OT-016-B	Flush sample; Sink with no bubbler in Rm 311; Sampled faucet	3/14/17 5:31 AM	None Detected
0100-031417-OT-017-A	Initial Draw sample; Sink with no bubbler in Rm 312; Sampled faucet	3/14/17 5:34 AM	None Detected
0100-031417-OT-017-B	Flush sample; Sink with no bubbler in Rm 312; Sampled faucet	3/14/17 5:35 AM	None Detected

**Table 1. Summary of Lead in Drinking Water Laboratory Analytical Results**

**Narvie Harris Elementary School**

3981 McGill Drive, Decatur, GA 30034



Sample ID*	Sample Location Description	Sample Date & Time	Lead Test Results (ppb)
0100-031417-OT-018-A	Initial Draw sample; Sink with no bubbler in Rm 310; Sampled faucet	3/14/17 5:40 AM	1.02
0100-031417-OT-018-B	Flush sample; Sink with no bubbler in Rm 310; Sampled faucet	3/14/17 5:41 AM	None Detected
0100-031417-OT-019-A	Initial Draw sample; Sink with no bubbler in Rm 308; Sampled faucet	3/14/17 5:44 AM	None Detected
0100-031417-OT-019-B	Flush sample; Sink with no bubbler in Rm 308; Sampled faucet	3/14/17 5:45 AM	None Detected
0100-031417-OT-020-A	Initial Draw sample; Sink with no bubbler in Rm 306; Sampled faucet	3/14/17 5:48 AM	None Detected
0100-031417-OT-020-B	Flush sample; Sink with no bubbler in Rm 306; Sampled faucet	3/14/17 5:49 AM	None Detected
0100-031417-OT-021-A	Initial Draw sample; Sink with no bubbler in Rm 304; Sampled faucet	3/14/17 5:51 AM	1.05
0100-031417-OT-021-B	Flush sample; Sink with no bubbler in Rm 304; Sampled faucet	3/14/17 5:52 AM	None Detected
0100-031417-OT-022-A	Initial Draw sample; Sink with no bubbler in Rm 302; Sampled faucet	3/14/17 5:55 AM	1.93
0100-031417-OT-022-B	Flush sample; Sink with no bubbler in Rm 302; Sampled faucet	3/14/17 5:56 AM	None Detected
0100-031417-OT-023-A	Initial Draw sample; Sink with no bubbler in Rm 401; Sampled faucet	3/14/17 6:00 AM	2.69
0100-031417-OT-023-B	Flush sample; Sink with no bubbler in Rm 401; Sampled faucet	3/14/17 6:01 AM	None Detected
0100-031417-OT-024-A	Initial Draw sample; Sink with no bubbler in Rm 403; Sampled faucet	3/14/17 5:56 AM	None Detected
0100-031417-OT-024-B	Flush sample; Sink with no bubbler in Rm 403; Sampled faucet	3/14/17 5:57 AM	None Detected
0100-031417-OT-025-A	Initial Draw sample; Sink with no bubbler in Rm 405; Sampled faucet	3/14/17 5:48 AM	None Detected
0100-031417-OT-025-B	Flush sample; Sink with no bubbler in Rm 405; Sampled faucet	3/14/17 5:49 AM	None Detected
0100-031417-OT-026-A	Initial Draw sample; Sink with no bubbler in Rm 407; Sampled faucet	3/14/17 5:24 AM	9.20
0100-031417-OT-026-B	Flush sample; Sink with no bubbler in Rm 407; Sampled faucet	3/14/17 5:25 AM	None Detected
0100-031417-OT-027-A	Initial Draw sample; Sink with no bubbler in Rm 409; Sampled faucet	3/14/17 5:15 AM	None Detected
0100-031417-OT-027-B	Flush sample; Sink with no bubbler in Rm 409; Sampled faucet	3/14/17 5:16 AM	None Detected
0100-031417-OT-028-A	Initial Draw sample; Sink with no bubbler in Rm 412; Sampled faucet	3/14/17 5:11 AM	None Detected
0100-031417-OT-028-B	Flush sample; Sink with no bubbler in Rm 412; Sampled faucet	3/14/17 5:12 AM	None Detected
0100-031417-OT-029-A	Initial Draw sample; Sink with no bubbler in Rm 411; Sampled faucet	3/14/17 5:13 AM	None Detected
0100-031417-OT-029-B	Flush sample; Sink with no bubbler in Rm 411; Sampled faucet	3/14/17 5:14 AM	None Detected
0100-031417-OT-030-A	Initial Draw sample; Sink with no bubbler in Rm 410; Sampled faucet	3/14/17 5:22 AM	None Detected
0100-031417-OT-030-B	Flush sample; Sink with no bubbler in Rm 410; Sampled faucet	3/14/17 5:23 AM	None Detected
0100-031417-OT-031-A	Initial Draw sample; Sink with no bubbler in Rm 402; Sampled faucet	3/14/17 5:58 AM	None Detected
0100-031417-OT-031-B	Flush sample; Sink with no bubbler in Rm 402; Sampled faucet	3/14/17 5:59 AM	None Detected



**Table 1. Summary of Lead in Drinking Water Laboratory Analytical Results**

**Narvie Harris Elementary School**

3981 McGill Drive, Decatur, GA 30034



Sample ID*	Sample Location Description	Sample Date & Time	Lead Test Results (ppb)
0100-031417-OT-032-A	Initial Draw sample; Sink with no bubbler in Rm 406; Sampled faucet	3/14/17 5:46 AM	None Detected
0100-031417-OT-032-B	Flush sample; Sink with no bubbler in Rm 406; Sampled faucet	3/14/17 5:47 AM	None Detected
0100-031417-OT-033-A	Initial Draw sample; Sink with no bubbler in Rm 404; Sampled faucet	3/14/17 5:50 AM	None Detected
0100-031417-OT-033-B	Flush sample; Sink with no bubbler in Rm 404; Sampled faucet	3/14/17 5:51 AM	None Detected
0100-031417-OT-035-A	Initial Draw sample; Sink with no bubbler in Rm 408; Sampled faucet	3/14/17 5:35 AM	None Detected
0100-031417-OT-035-B	Flush sample; Sink with no bubbler in Rm 408; Sampled faucet	3/14/17 5:36 AM	None Detected
0100-031417-RS-001-A	Initial Draw sample; Girls RR next to Rm 407; Sink on far right; Faucet detached from sink	3/14/17 5:26 AM	None Detected
0100-031417-RS-001-B	Flush sample; Girls RR next to Rm 407; Sink on far right; Faucet detached from sink	3/14/17 5:27 AM	None Detected
0100-031417-TL-001-A	Initial Draw sample; Only sink in Teachers Lounge Rm 2.14	3/14/17 5:15 AM	None Detected
0100-031417-TL-001-B	Flush sample; Only sink in Teachers Lounge Rm 2.14	3/14/17 5:16 AM	None Detected
0100-031417-TL-002-A	Initial Draw sample; Only sink in Teachers Lounge in Library; Sampled faucet	3/14/17 5:30 AM	None Detected
0100-031417-TL-002-B	Flush sample; Only sink in Teachers Lounge in Library; Sampled faucet	3/14/17 5:31 AM	None Detected
0100-031417-CS-001-A	Initial Draw sample; Food Prep sink next to walk in cooler in Kitchen; Dripping on arrival	3/14/17 5:00 AM	None Detected
0100-031417-CS-001-B	Flush sample; Food Prep sink next to walk in cooler in Kitchen; Dripping on arrival	3/14/17 5:02 AM	None Detected
0100-031417-IM-001-A	Scotsman Ice Machine in Kitchen	3/14/17 5:05 AM	None Detected
0100-031417-SC-001-A	Service Connection entry into building	3/14/17 4:56 AM	None Detected

**Notes:**

ppb-parts per billion

**Bold**-Exceeds 15 ppb--EPA's Action Level for Lead

\* Note--Where "A" and "B" are indicated, AEM collected two samples at each source area location: ("A") initial draw sample; and ("B") after a 30-second flush sample





December 4, 2017

**Via E-Mail: Joshua\_I\_williams@dekalbschoolsga.org**

Mr. Joshua L. Williams, MBA, MSM, PMP  
Chief Operations Officer  
DeKalb County School District  
Operations Division  
Sam Moss Service Center  
1780 Montreal Road  
Tucker, Georgia 30084

**Re: Summary of Additional Lead in Drinking Water Sample Results  
Narvie Harris Elementary School (Facility ID #0100)  
3981 McGill Drive, Decatur, Georgia 30034  
AEM Project No. 1561-1601**

Dear Mr. Williams:

Atlanta Environmental Management, Inc. (AEM) is pleased to provide the DeKalb County School District (DCSD) an electronic copy of the Lead in Drinking Water Sample Results for Narvie Harris Elementary School (Facility ID #0100). Additional drinking water samples from select source units were collected on September 26, 2017, November 10, 2017, and November 30, 2017, and analytical results were received from Analytical Environmental Services, Inc., on October 9, 2017, November 17, 2017, and December 1, 2017.

## **FINDINGS**

### ***Sample Results of Previously Identified Source Units That Exceeded 15 ppb***

During the initial sampling event on March 14, 2017, one source unit (OT-010) was sampled and the analytical results indicated that the results were above EPA's action level of 15 parts per billion (ppb). DCSD replaced the source unit and AEM collected two drinking water samples on September 26, 2017. One or more samples collected from OT-010 contained lead at a concentration exceeding EPA's action level of 15 ppb. Source unit OT-010 remained out of service to evaluate additional remedial alternatives.

DCSD installed a filter on OT-010 and AEM collected two samples on November 10, 2017. One or more samples collected from OT-010 contained lead at a concentration exceeding EPA's action level of 15 ppb. Source unit OT-010 remained out of service to evaluate additional remedial alternatives.

DCSD installed a second filter and AEM collected two drinking water samples on November 30, 2017. None of the samples collected contained lead at a concentration exceeding EPA's action level of 15 ppb.

A description of the drinking water outlets sampled and a summary of sample analytical results are provided in Table 1.


We appreciate your selection of AEM for this project. If you have any questions, please do not hesitate to contact us.

Sincerely,

**Atlanta Environmental Management, Inc.**



Leona Miles, CHMM  
Senior Project Manager

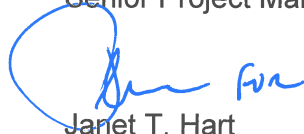

Janet T. Hart  
President

/krf

cc: Daniel Drake (DCSD)  
Tracee Hill (DCSD)  
Sandra Glenn (DeKalb County Watershed Management)  
Ryan Cira (DeKalb Board of Health)

Attachment: Table

**Table 1. Summary of Lead in Drinking Water Laboratory Analytical Retest Results**  
**Narvie Harris Elementary School**  
 3981 McGill Drive, Decatur, GA 30034



Sample ID**/**	Sample Location Description	Sample Date & Time	Lead Test Results (ppb)
0100-113017-OT-010-A	Initial Draw sample; Retest Sink with no bubbler in Rm 202; Sampled from faucet; second filter added	11/30/17 5:12 AM	4.12
0100-113017-OT-010-B	Flush sample; Retest Sink with no bubbler in Rm 202; Sampled from faucet; second filter added	11/30/17 5:13 AM	None Detected

**Notes:**

ppb-parts per billion

**Bold**-Exceeds 15 ppb--EPA's Action Level for Lead

\* Note--Where "A" and "B" are indicated, AEM collected two samples at each source area location: ("A") initial draw sample; and ("B") after a 30-second flush sample

\*\*The source unit was initially sampled on 3/14/17 and the initial results indicated that a concentration exceeded the EPA standard of 15 ppb. The source unit was replaced and a filter was installed by DCSD and retesting was conducted. The above summarizes the retest results.